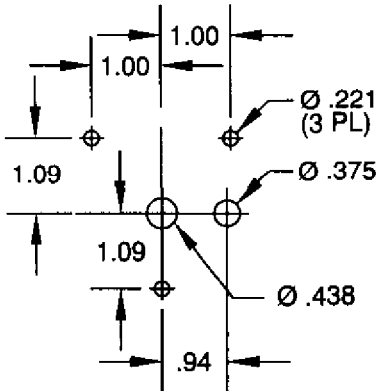
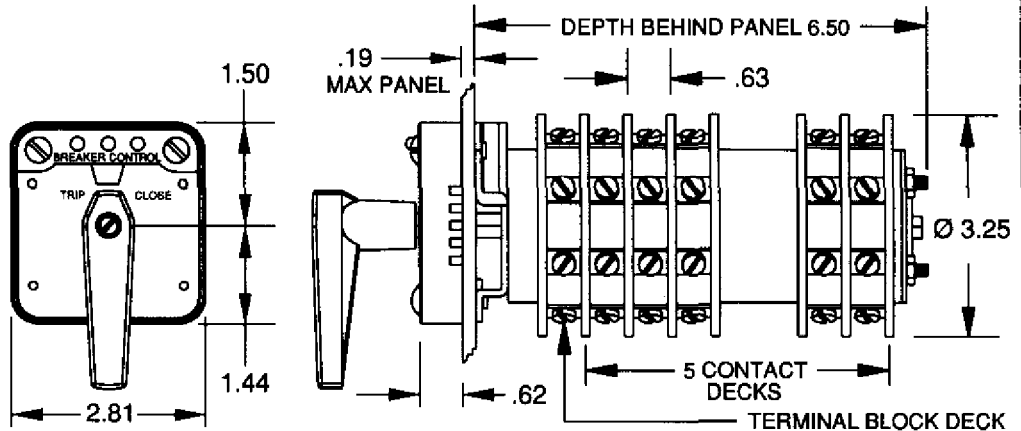




**ELECTROSWITCH**UNIT OF ELECTRO SWITCH CORP.
WEYMOUTH, MASSACHUSETTS 02188

TEL: (781)335-5200 FAX: (781)335-4253

**SERIES 24
CONTROL SWITCH****24PD57D****PANEL DRILLING**(3) #10-32
MOUNTING SCREWS
SUPPLIED# 8-32 X .25
BD. HD. TERMINAL SCREWS
SUPPLIED UN-ASSEMBLED.FILE NO.
E1817420A-120VAC
15A-240VAC
6A-600VAC
3A-125VDC
1A-250VDC20A-600VAC res
15A-600VAC ind
2A-125VDC
2HP-240/480VDC**TITLE: BREAKER CONTROL**

DECK	CONTACTS	POSITION ENGRAVING			
		TRIP	(nat)	(nac)	CLOSE
		POSITIONS			
		2 FROM			
		1	1	3	3
1	12 13				X
	16 17				X
2	21 28	X			
	24 25	X			
3	31 32		X	X	
	35 36		X	X	
4	42 43				X
	46 47				X
5	51 52	X	X		
	55 56	X	X		


**HANDLE
POSITIONS****ENGRAVING CODE**

124B-2B23


ACTION: SPRING RETURN TO POS. 2.

H	A	B	C	D	E	F	G
●	●	●	●	●	●	●	●
11 ○	12 ●	13 ●	14 ○	15 ○	16 ●	17 ●	18 ○
21 ●	22 ○	23 ○	24 ●	25 ●	26 ○	27 ○	28 ●
31 ●	32 ●	33 ○	34 ○	35 ●	36 ●	37 ○	38 ○
41 ○	42 ●	43 ●	44 ○	45 ○	46 ●	47 ●	48 ○
51 ●	52 ●	53 ○	54 ○	55 ●	56 ●	57 ○	58 ○

TERMINALS SUPPLIED AS SHOWN

CONTACT DECKS

DECKS 1-3 BBM

DECKS 4 & 5 BBM
SLIP DECKSMADE BY: WDS
APPR BY: CJL

DATE: 2/18/00

DATE: 2/18/00

SHEET 1 OF 2

REV

D

DIECN 26551

DIECN 26007

DIECN 25840

DIECN 25544

REVISIONS:

WCK BEN 3/8/02 WCK



WCK DPK 4/26/01 WCK

WCK AMN 12/19/00 WCK

WCK WDS 5/11/00 C.J.L.

**ELECTROSWITCH**UNIT OF ELECTRO SWITCH CORP.
WEYMOUTH, MASSACHUSETTS 02188

TEL: (781)335-5200 FAX: (781)335-4253

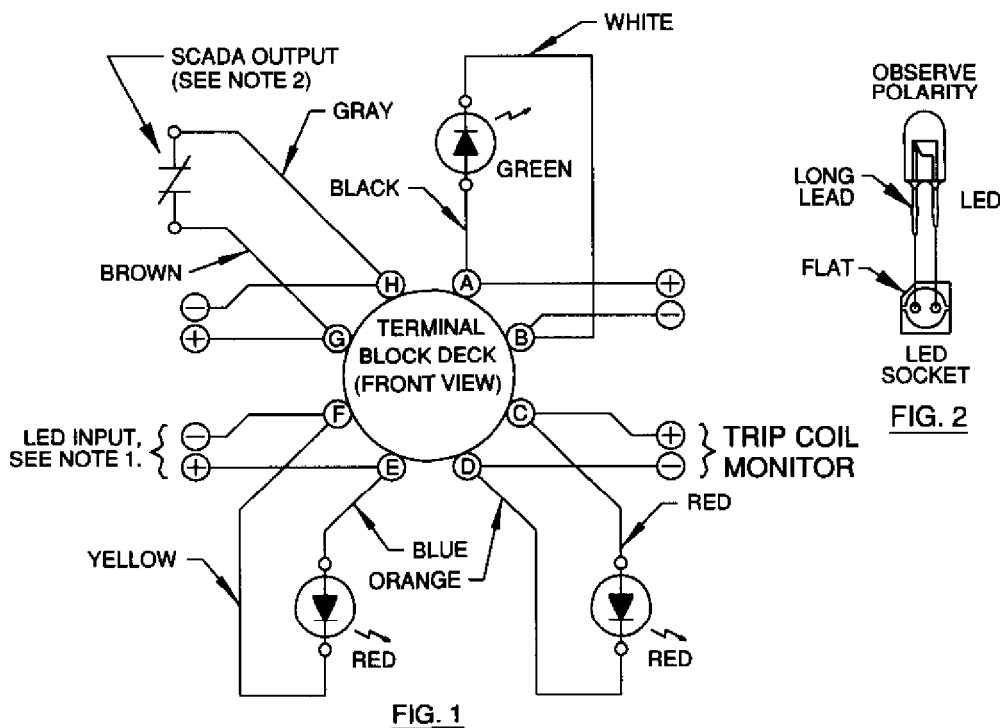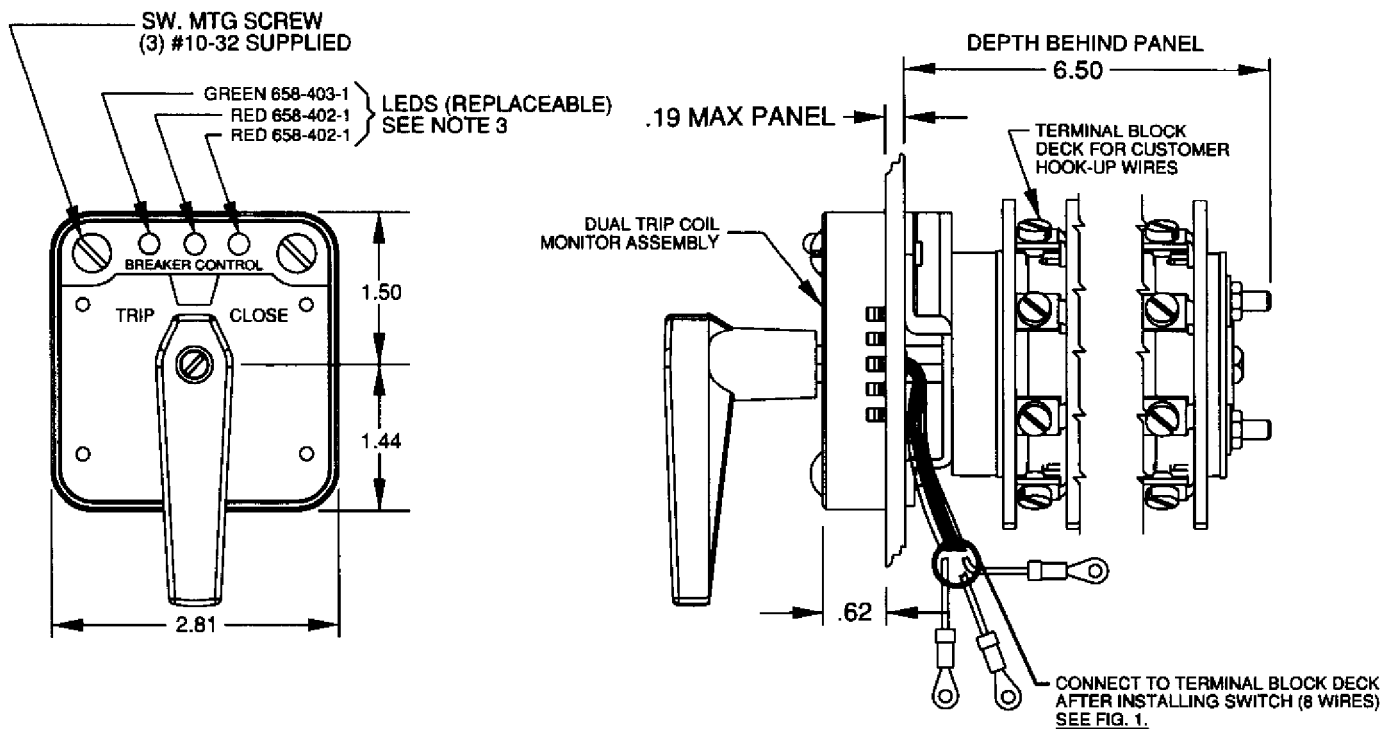**SERIES 24
BREAKER CONTROL
SWITCH****24PD57D****LED VOLTAGE: 37-140 VDC****NOTES:**

1. OPERATING VOLTAGE FOR LED NAMEPLATE: 37-140 VDC.
2. SCADA OUTPUT IS CONTROLLED BY TRIP COIL MONITOR. (100 mA MAX)
3. OBSERVE POLARITY WHEN INSERTING LED IN SOCKET (SEE FIG. 2)
4. FACTORY PIN AT 3.259 FROM HANDLE END.

MADE BY: **WDS**
APPR BY: **CJL**

DATE: 2/18/00

DATE: 2/18/00

SHEET 2 OF 2

REV
D

REVISIONS: SEE SHEET 1